


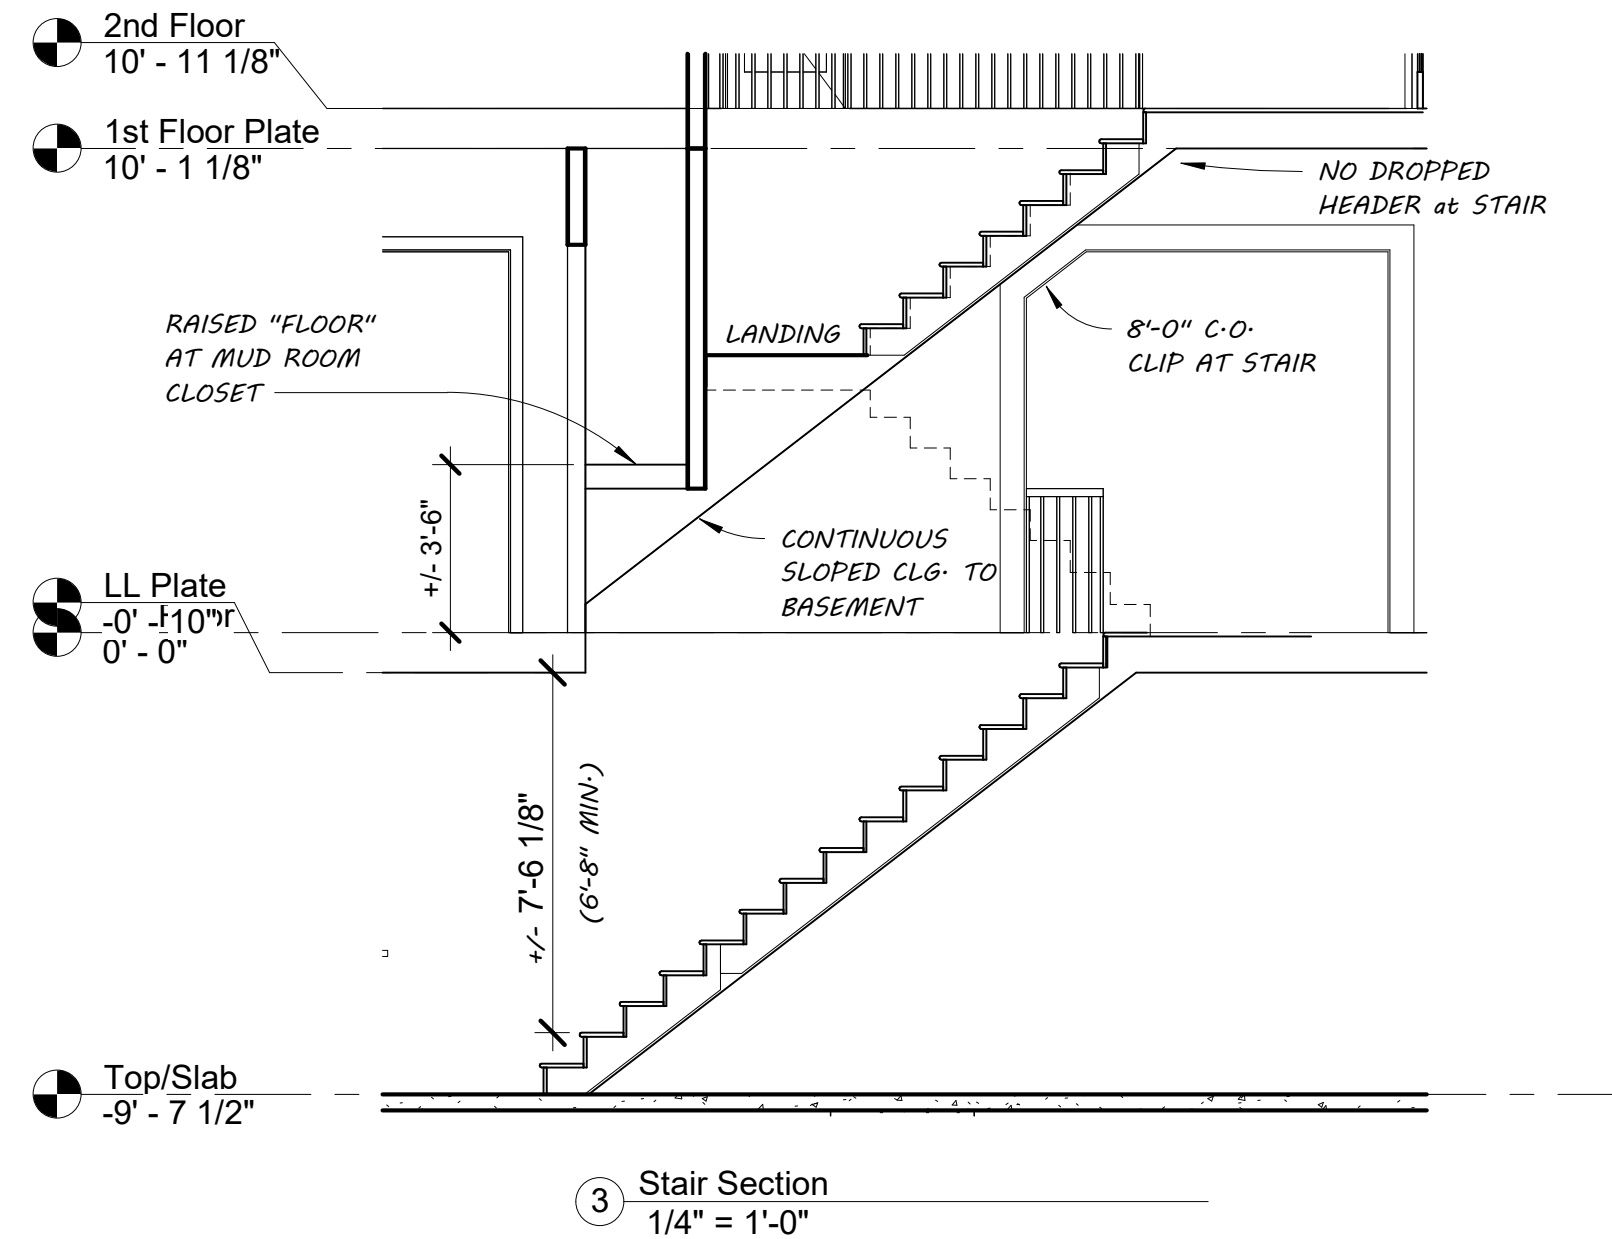

- TRUSS ROOF NOTES: (BY OTHERS)
- DESIGNED FOR LIGHT ROOF COVERING
TOP CHORD:
LIVE LOAD/ SNOW LOAD (PSF): 20
DEAD LOAD (PSF): 10
BOTTOM CHORD:
DEAD LOAD (PSF): 10
 - ALL EXTERIOR HEADERS SHALL BE MIN (2) #2-2x10 UNLESS OTHERWISE NOTED
 - CONSULT ENGINEER IF TRUSSES BEAR ON INTERIOR WALLS SHOWN AS NON-LOAD BEARING ON APPROVED PRINTS.
 - MIN (4) 2x4 BELOW EACH BEARING POINT OF EACH GIRDER TRUSS, UNLESS OTHERWISE NOTED.
 - PROVIDE 2x SOLID BLOCKING SUPPORT BELOW ALL POINT LOADS CONTINUOUS TO BEARING STRUCTURE AND/OR FOUNDATION BELOW.
 - ROOF IS ENGINEERED TO COMPLY WITH IRC 802.
 - AT EACH TRUSS BEARING POINT USE UPLIFT CONNECTORS PER TABLE BELOW UNLESS NOTED OTHERWISE, INSTALL PER MANUFACTURER'S SPECIFICATIONS.
- | | |
|---------------|-----------|
| LBS OF UPLIFT | CONNECTOR |
| 000-495 | (1) H2.5A |
| 495-990 | (2) H2.5A |
| 990-1245 | (1) HTS20 |

→ = ASSUMED ROOF TRUSS FRAMING DIRECTION
"G.T." = ASSUMED GIRDER TRUSS LOCATION
= ASSUMED INTERIOR LOAD BEARING WALLS

BRACED WALL METHODOLOGY
CONTINUOUS EXTERIOR SHEATHING PER WSP METHOD (BELOW)
UNLESS OTHERWISE NOTED ON THE PLAN


CS-WSP: WOOD STRUCTURAL PANEL SHEATHING WITH A THICKNESS NOT LESS THAN 3/8" WITH MINIMUM SPAN RATING OF 24/0 FOR 16" OC STUD SPACING WITH 6d COMMON NAILS AT 6" OC EDGES AND 12" OC FIELD OR SHEATHING THICKNESS NOT LESS THAN 7/16" WITH MINIMUM SPAN RATING OF 24/16 FOR 24" OC SPACING WITH 8d COMMON NAILS AT 6" OC EDGES AND 12" OC IN FIELD.
(NOTE: FRAMING MEMBERS 16" OC MAX, UNBLOCKED, AND WITH SHEATHING APPLIED DIRECTLY TO FRAMING MEMBERS)

INTERIOR BRACED WALLS (REF 2-S4.0):
GB METHOD: 1/2" MIN GYPSUM BOARD OVER STUDS SPACED 24" MAX FASTENED WITH No 6 - 1 1/4" TYPE "W" OR "S" DRYWALL SCREWS AT 7" OC EDGES AND FIELD (MIN 4'-0" SECTION FOR BOTH SIDES.)

OR

LIB METHOD: 1x4 WOOD FASTENED WITH (3) 8d COMMON NAILS OR SIMPSON / USP 16 GA TYPE WB (OR EQUAL) STL X-BRACE(S) AT 45° TO 60° ANGLES, MAXIMUM 16" OC STUD FASTENED PER MANUFACTURER'S SPECIFICATIONS.

STRUCTURAL NOTES:
- ALL UNMARKED HEADERS
MIN (2) #2-2x10
- ALL HEADERS AND BEAMS MIN
#2 GRADE DFL (OR EQUIV)
- = BEARING WALL

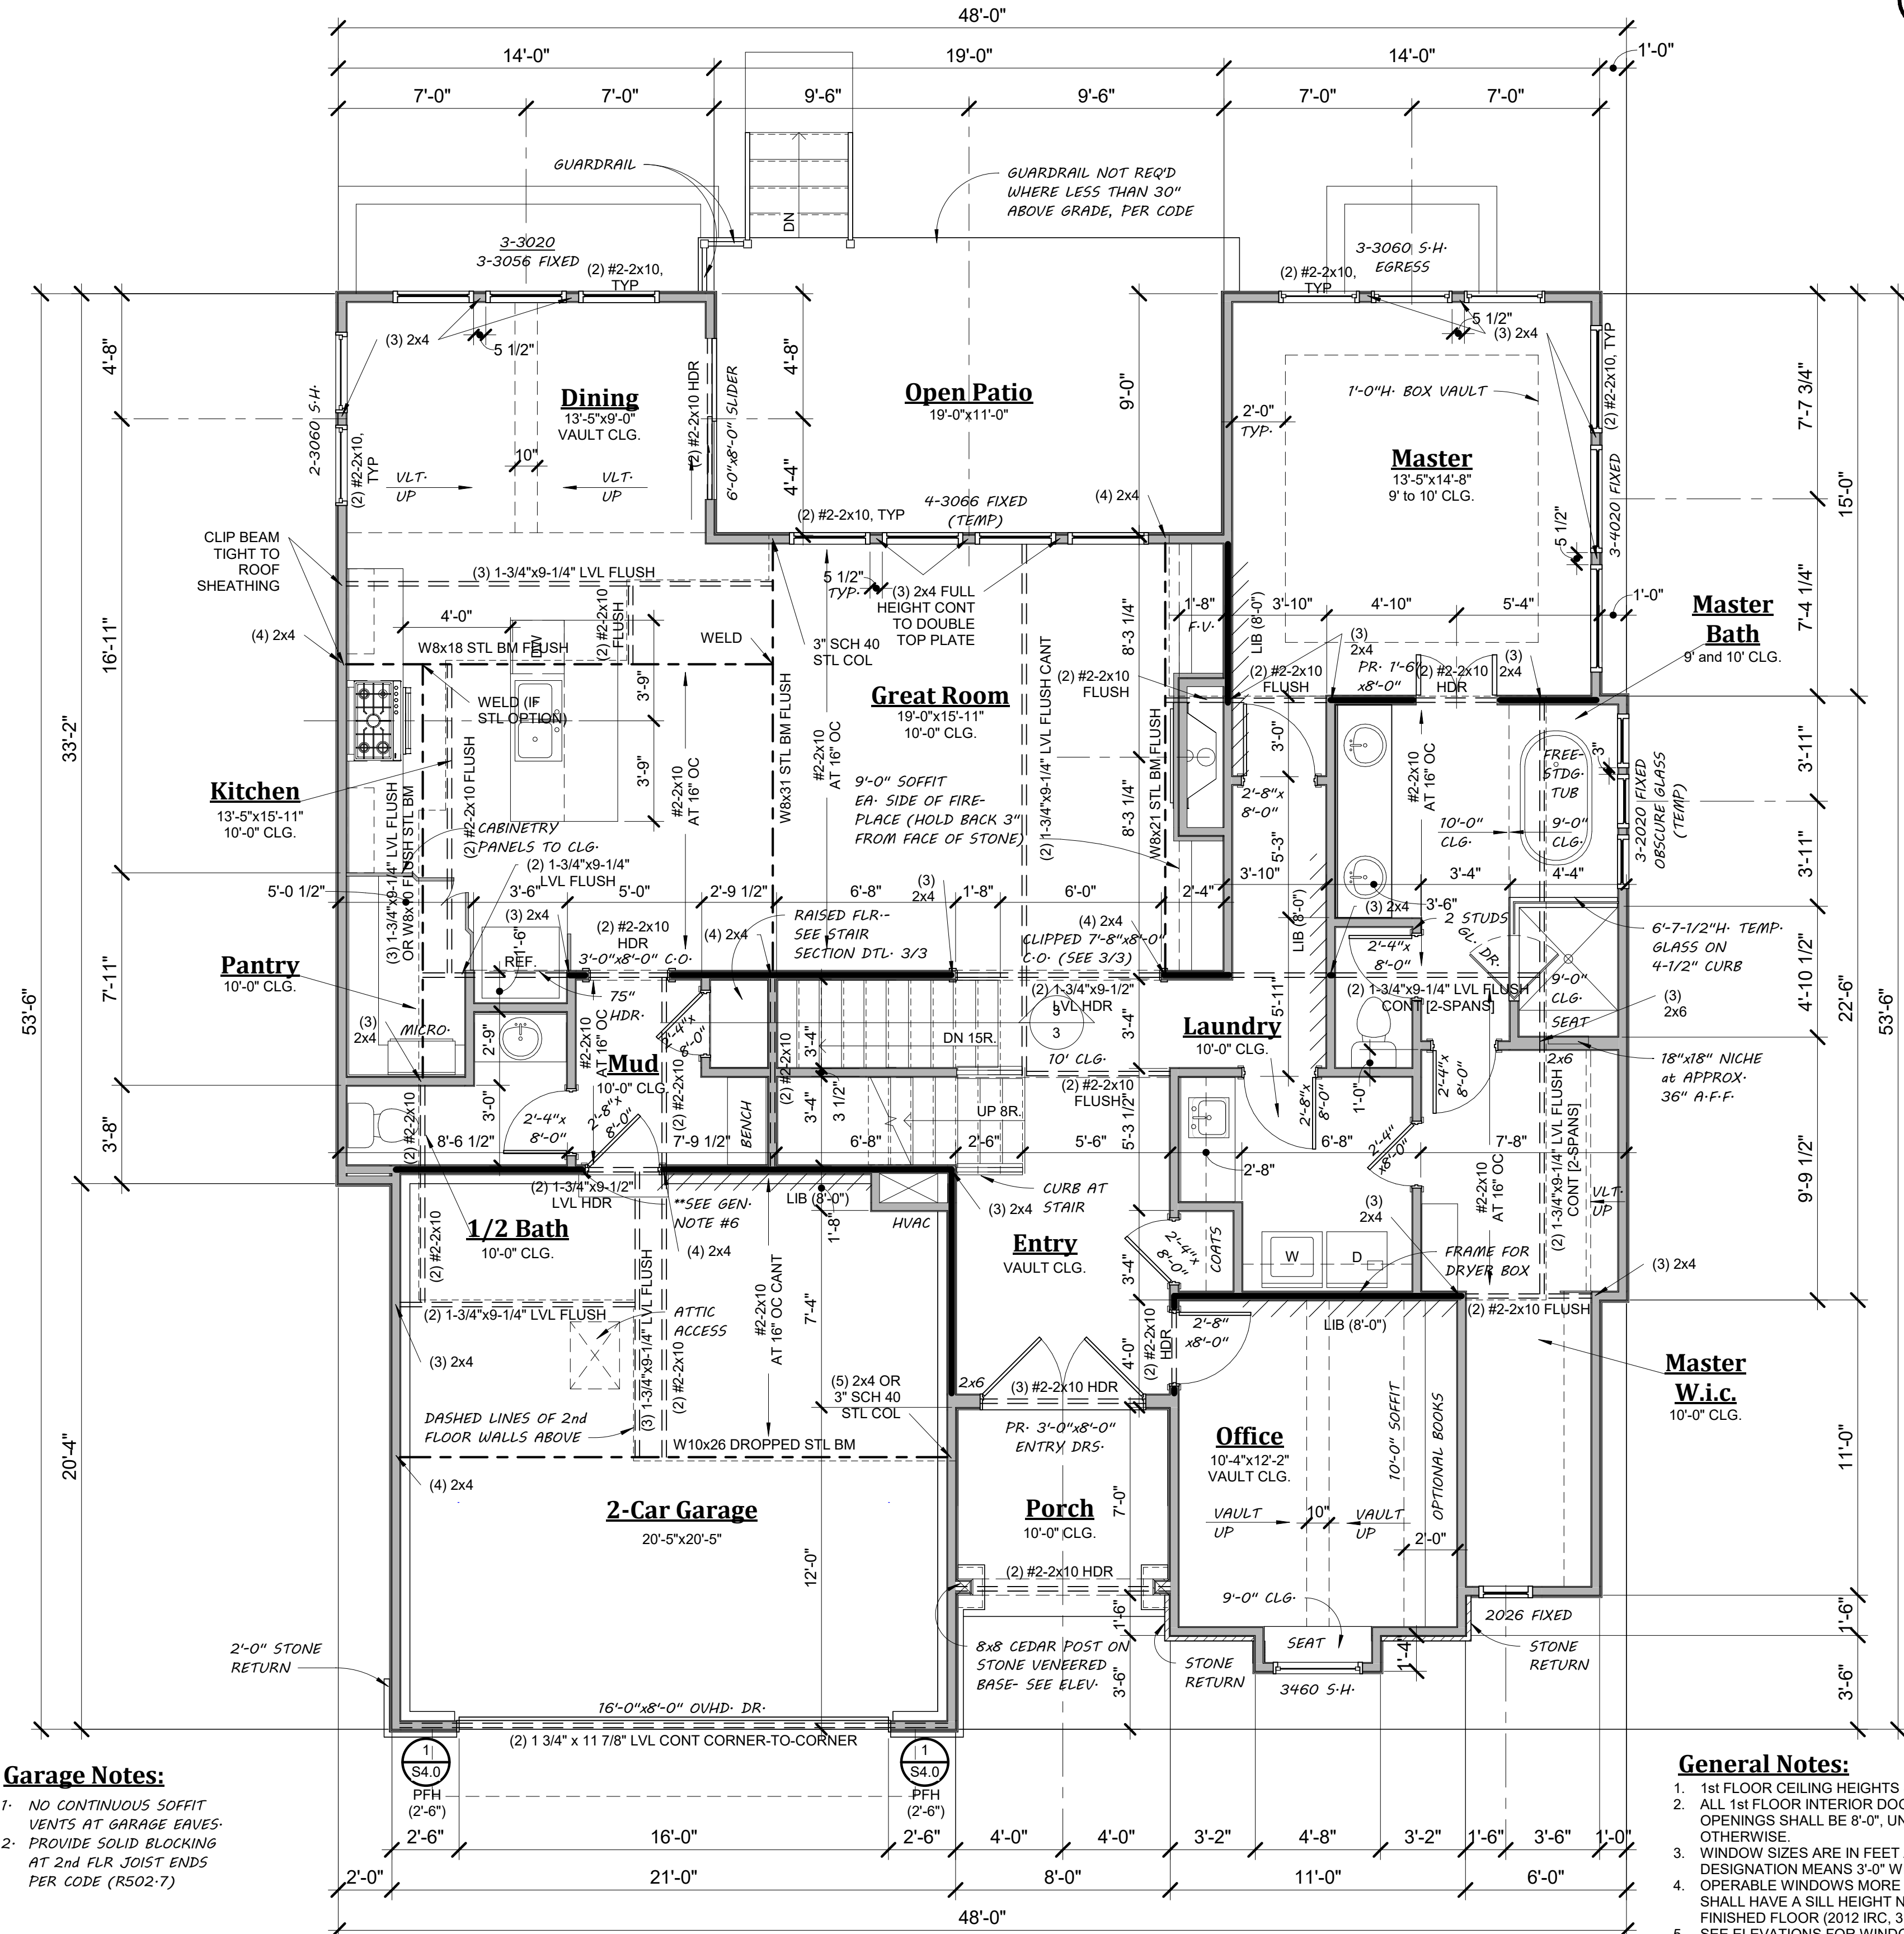


Garage Notes:

- NO CONTINUOUS SOFFIT VENTS AT GARAGE EAVES.
- PROVIDE SOLID BLOCKING AT 2nd FLR JOIST ENDS PER CODE (R502.7)

General Notes:

- 1st FLOOR CEILING HEIGHTS SHALL BE AS INDICATED.
- ALL 1st FLOOR INTERIOR DOORS AND CASED OPENINGS SHALL BE 8'-0", UNLESS NOTED OTHERWISE.
- WINDOW SIZES ARE IN FEET AND INCHES. 3050 DESIGNATION MEANS 3'-0" WIDE x 5'-0" HIGH.
- OPERABLE WINDOWS MORE THAN 6" ABOVE GRADE SHALL HAVE A SILL HEIGHT NO LESS THAN 24" ABOVE FINISHED FLOOR (2012 IRC, 312.2)
- SEE ELEVATIONS FOR WINDOW HEAD HEIGHTS.
- 3 STUDS STANDARD AT INSIDE CORNER OF INTERIOR DOORS TO ACCOMMODATE 3 1/2" TRIM WHERE POSSIBLE

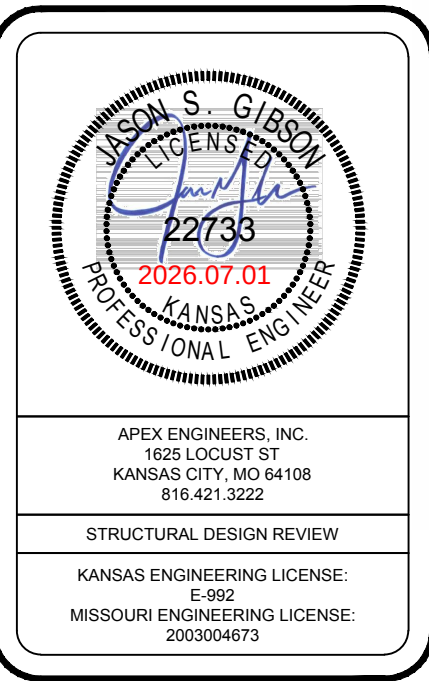

JAMES ENGLE
CUSTOM HOMES
COPYRIGHT

REPRODUCTION OF THESE PLANS IN WHOLE OR PART OR
THE PREPARATION OF DERIVATIVE WORKS THEREOF
WITHOUT THE WRITTEN CONSENT OF JAMES ENGLE
CUSTOM HOMES IS PROHIBITED.

The Princeton

TRADITIONAL

LOT 26, BLOCK 39, 7225 LINDEN ST., PRAIRIE VILLAGE, KANSAS

James Engle
CUSTOM HOMES, LLC


www.JamesEngle.com

Date:
June 22, 2026

Revised:

Sheet No.

3

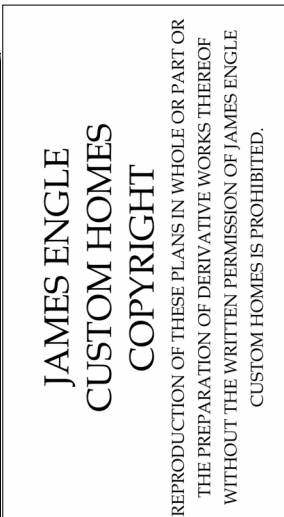

TRADITIONAL

LOT 26, BLOCK 39, 7225 LINDEN ST., PRAIRIE VILLAGE, KANSAS

CUSTOM HOMES, LLC

816-616-9788 www.JamesEngle.com

Revised:

Sheet No. _____


4

- = ASSUMED ROOF TRUSS FRAMING DIRECTION
 "G.T." = ASSUMED GIRDER TRUSS LOCATION
 = ASSUMED INTERIOR LOAD BEARING WALLS


CS-WSP: WOOD STRUCTURAL PANEL SHEATHING WITH A THICKNESS NOT LESS THAN 3/8" WITH MINIMUM SPAN RATING OF 24/0 FOR 16" OC STUD SPACING WITH 6d COMMON NAILS AT 6" OC EDGES AND 12" OC FIELD OR SHEATHING THICKNESS NOT LESS THAN 7/16" WITH MINIMUM SPAN RATING OF 24/16 FOR 24" OC SPACING WITH 8d COMMON NAILS AT 6" OC EDGES AND 12" OC IN FIELD.
(NOTE: FRAMING MEMBERS 16" OC MAX, UNBLOCKED, AND WITH SHEATHING APPLIED DIRECTLY TO FRAMING MEMBERS)

LIB METHOD: 1x4 WOOD FASTENED WITH (3) 8D COMMON NAILS OR SIMPSON / USP 16 GA TYPE WB (OR EQUAL) STL X-BRACE(S) AT 45° TO 60° ANGLES, MAXIMUM 16" OC STUD FASTENED PER MANUFACTURER'S SPECIFICATIONS.

STRUCTURAL NOTES:
- ALL UNMARKED HEADERS
MIN (2) #2-2x10
- ALL HEADERS AND BEAMS MIN
#2 GRADE DF/L (OR EQUIV)
- = BEARING WALL



1. 2nd FLOOR CEILING HEIGHTS SHALL BE AS INDICATED
2. ALL 2nd FLOOR INTERIOR DOORS AND CASED OPENINGS SHALL BE 6'-8", UNLESS NOTED OTHERWISE.
3. WINDOW SIZES ARE IN FEET AND INCHES. 3050 DESIGNATION MEANS 3'-0" WIDE X 5'-0" HIGH.
4. OPERABLE WINDOWS MORE THAN 6' ABOVE GRADE SHALL HAVE A SILL HEIGHT NO LESS THAN 24" ABOVE FINISHED FLOOR (2012 IRC, 312.2)
5. SEE ELEVATIONS FOR WINDOW HEAD HEIGHTS.

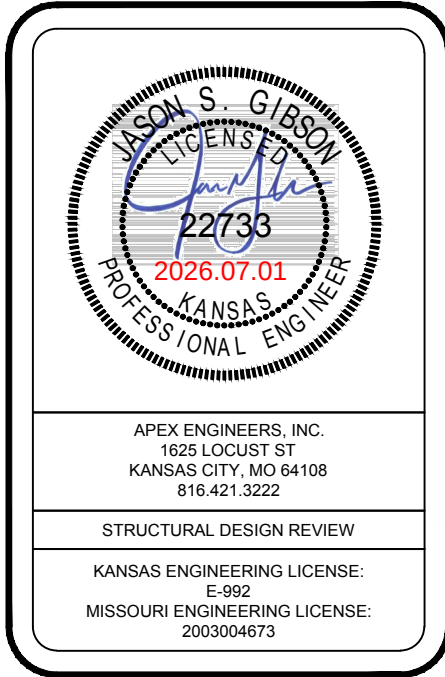

JAMES ENGLE
CUSTOM HOMES
COPYRIGHT
REPRODUCTION OF THESE PLANS IN WHOLE OR PART OR
THE PREPARATION OF DERIVATIVE WORKS THEREOF
WITHOUT THE WRITTEN PERMISSION OF JAMES ENGLE
CUSTOM HOMES IS PROHIBITED.

The Princeton
TRADITIONAL
LOT 26, BLOCK 39, 7225 LINDEN ST., PRAIRIE VILLAGE, KANSAS


James Engle
CUSTOM HOMES, LLC
816.616.9788 www.JamesEngle.com

Date:
June 22, 2026

Revised:

Sheet No.

7

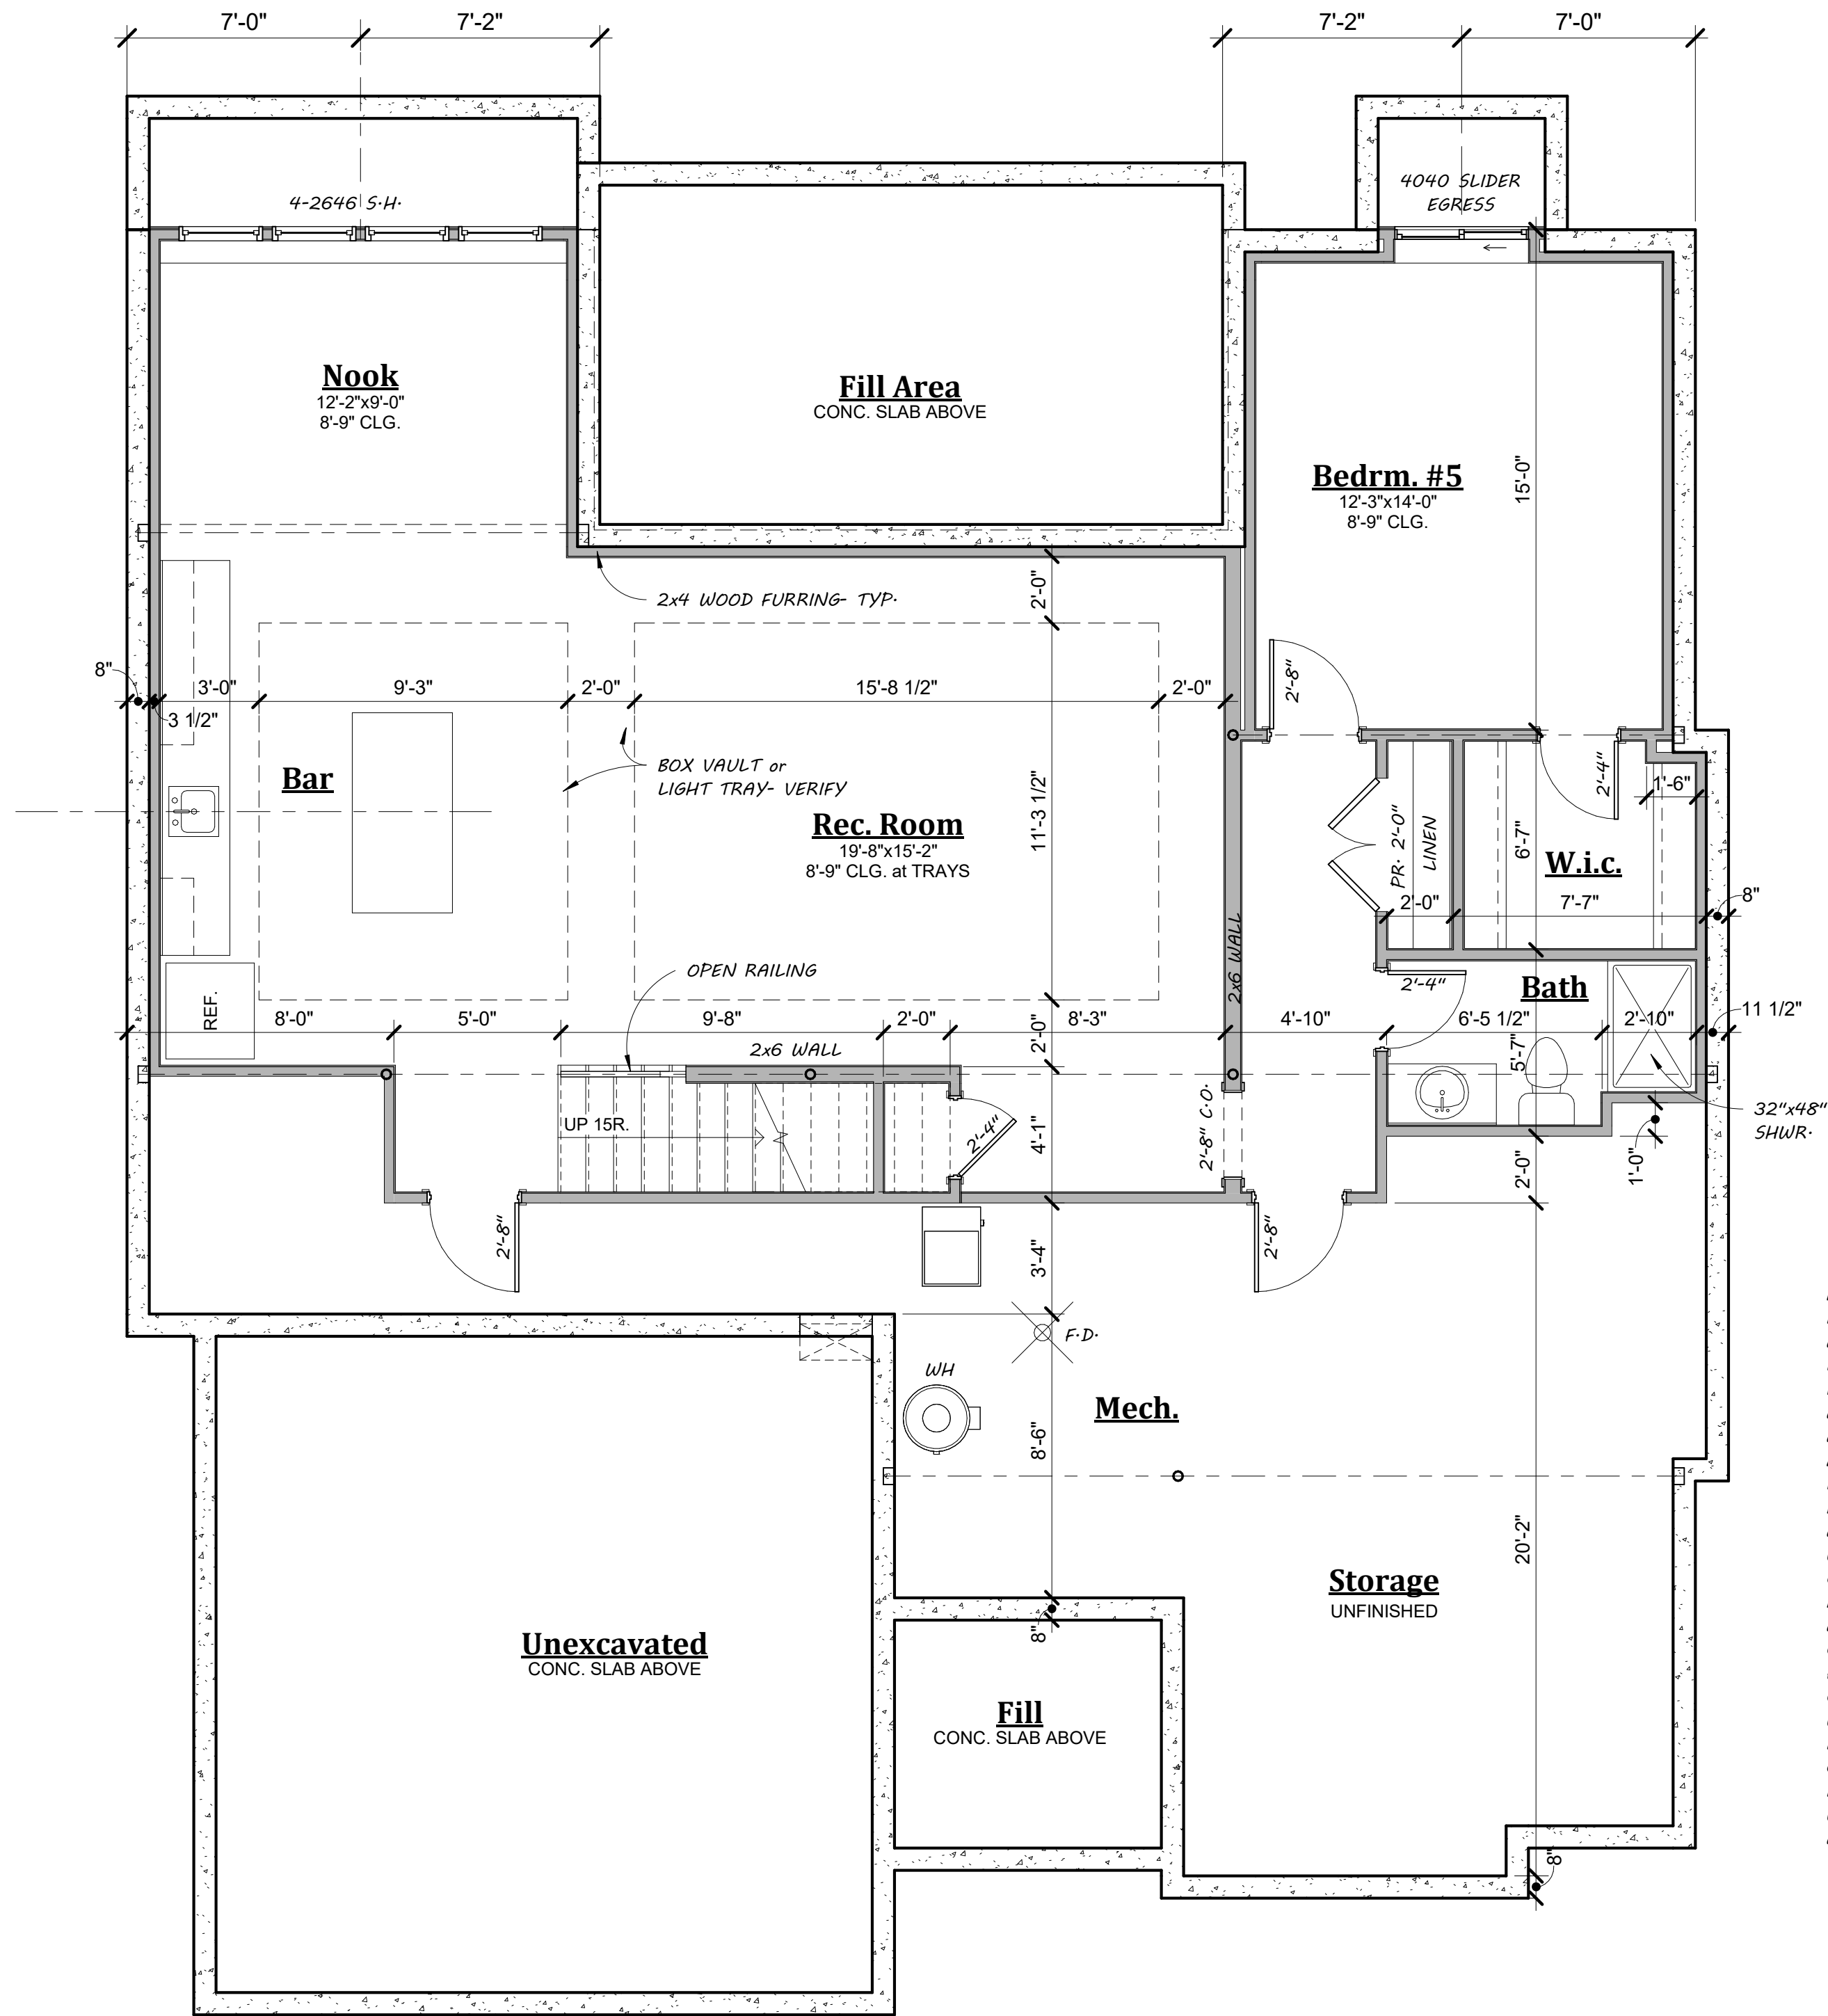

****Note**
HVAC/PLUMBING/ELECTRICAL
EQUIPMENT ON THE PLANS
ARE DESIGNATED AS A "GENERAL"
LOCATION FOR THE BASE PLAN.
IF YOU HAVE SPECIFIC REQUESTS
AS TO THE PLACEMENT,
A REQUEST IN WRITING MUST BE
MADE TO JECH. JECH CAN
RESEARCH TO SEE IF THE
PLACEMENT REQUEST CAN OCCUR
AND WHAT IT MIGHT COST. A
WRITTEN REQUEST DOES NOT
GUARANTEE THAT A CHANGE WILL
BE MADE. ELECTRICAL PANELS
ARE DICTATED BY THE ELECTRIC
COMPANY AND HAVE MANY
FACTORS THAT MUST BE
CONSIDERED, I.E. GAS METERS,
WINDOWS, LOCATION OF
ELECTRICAL CONNECTION
OUTSIDE, ETC.
EVERY REASONABLE ATTEMPT
WILL BE MADE TO RESPOND TO
A REQUEST.

1 Basement Finish Plan
1/4" = 1'-0"